


## Smartplumb High Gain DHW / Buffer Cylinder

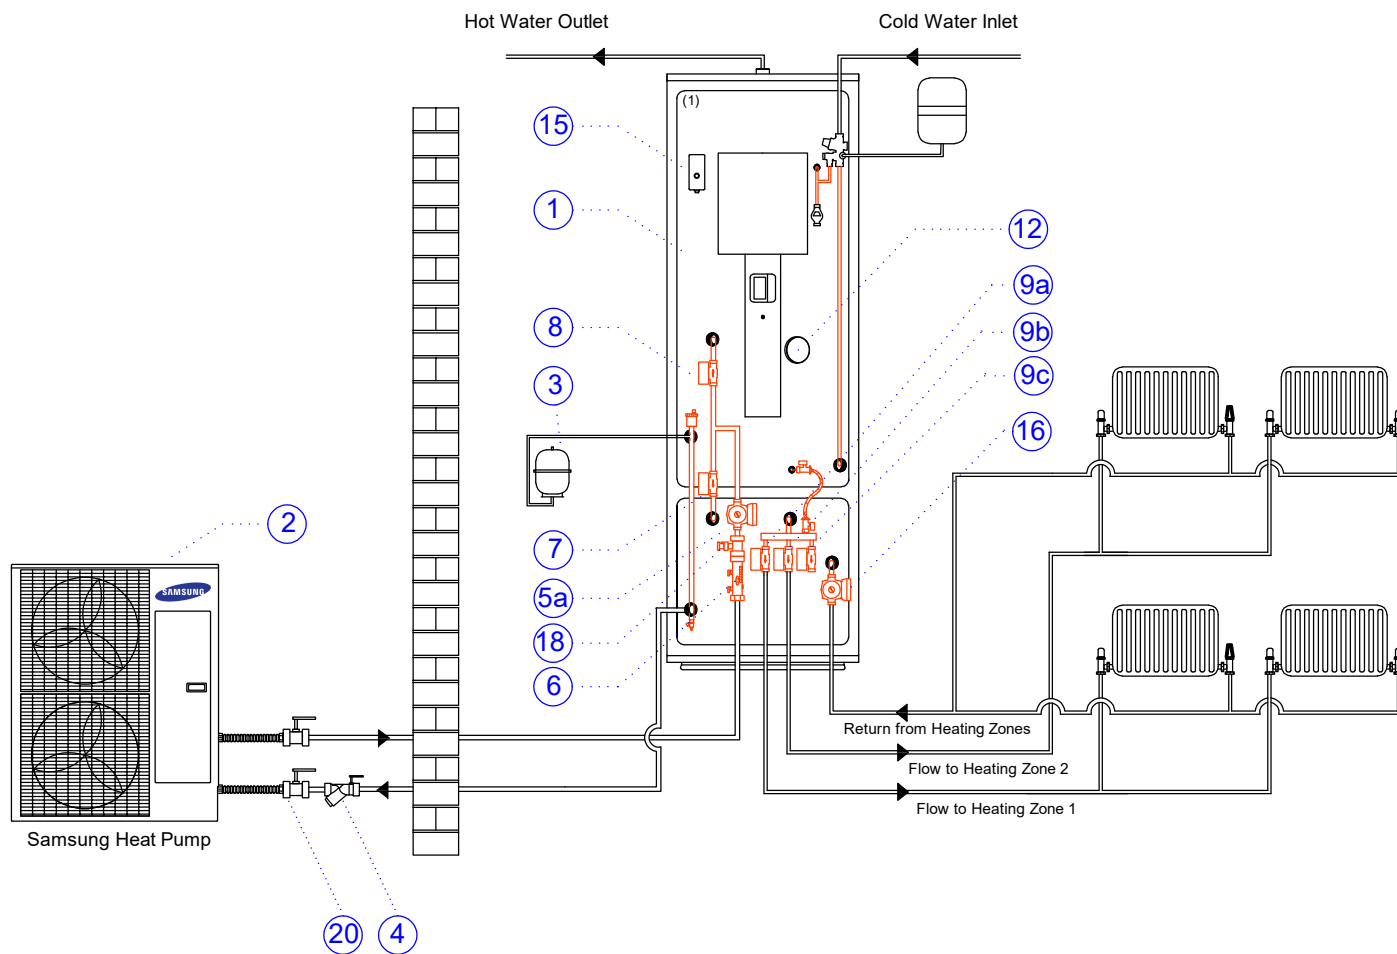

— Preplumbed Pipework

— Pipework to be installed by Installer

- |  |  |                                       |
|--|--|---------------------------------------|
| ① Joule Smartplumb DHW/ Buffer Cylinder              | ⑧ 28mm DHW 2 Port Zone Valve                 | ⑭ Buffer Tank Stat (Where applicable) |
| ② Samsung Heat Pump                                  | ⑨a 22mm 2 Port Zone Valve Heating Zone 1     | ⑮ DHW High Limit Stat                 |
| ③ Heating Expansion Vessel (Not Supplied)            | ⑨b 22mm 2 Port Zone Valve Heating Zone 2     | ⑯ Heating Zone Circulating Pump       |
| ④ 28mm Y-Strainer                                    | ⑨c 22mm 2 Port Zone Valve Heating Zone 3     | ⑰ UFH Circulation Pump                |
| ⑤a Primary Pump Flow from Heat Pump                  | ⑩ DHW Heat Pump Stat Pocket                  | ⑱ Samsung Heat Pump Flow Switch       |
| ⑤b Primary Pump Return to Heat Pump (Where Required) | ⑪ Solar Probe Stat Pocket (Where applicable) | ⑲ 2 Pole 20A NO Relay                 |
| ⑥ Flow Regulator / Flush and Fill Unit               | ⑫ DHW Immersion                              | ⑳ Isolation Valves                    |
| ⑦ 28mm Buffer 2 Port Zone Valve                      | ⑬ Buffer Tank Immersion (Where applicable)   | ㉑ ELCB                                |
|  |  | ㉒ Automatic Bypass Valve              |

Notes: All systems should be installed by a fully qualified engineer.

All systems should be installed in accordance with Building Regulations.

The minimum flow rate required is 16L per minute

The system should be power flushed for a minimum period of 1 hour to remove air.

HKD:	DATE:	CUSTOMER:	
JL	18/08/2021		
RN:	DATE:	INTERNAL CODE:	
JL	18/08/2021	PP_ASHP_SP_2RAD_M	
.PP'D:	DATE:	SCALE:	REV.:
JL	18/08/2021		00

Samsung Gen 6 Heat Pump  
Smartplumb 3 Zone  
2RAD\_1DHW

**joule**  
manufacturing excellence

